
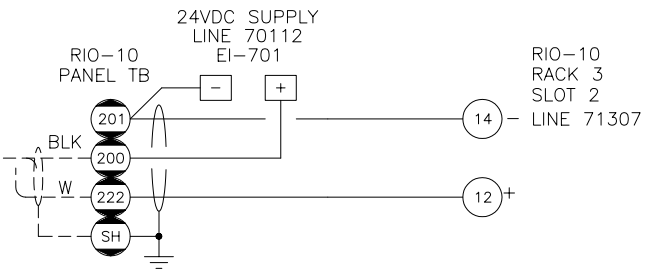
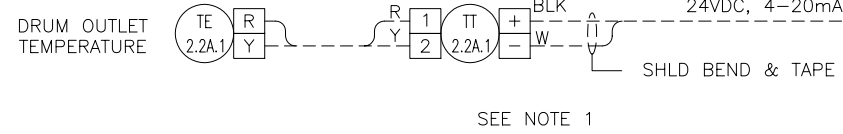
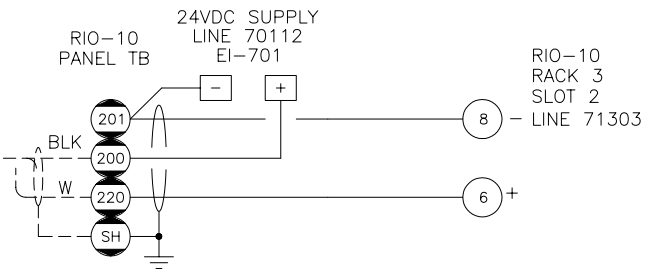


FIELD

REMOTE I/O


MCC BUCKET

PANEL



TAG	DESCRIPTION	MANUFACTURER	MODEL NO.	CALIBRATION
TT-2.1.1	TEMPERATURE TRANSMITTER	ROSEMOUNT	3144D1E5	0-1500°F
TE-2.1.1	THERMOCOUPLE TYPE "K"	TEM TEX	160-1KV-040-24.25	
TE-2.1.1	THERMOWELL	TEM TEX	119S-P-22.5 U22.5	
TE-2.2A.1	THERMOCOUPLE TYPE "K"	TEM TEX	160-1KV-040-13.75-PP6	
TE-2.2A.1	THERMOWELL	TEM TEX	119S-P-12.75 U12.75	
TT-2.2A.1	TEMPERATURE TRANSMITTER	ROSEMOUNT	3144D1E5	0-300°F

RELEASED 12/08/06
REVISION - 0



DATE:	3/18/06
DRAWN BY:	BB
CHECKED BY:	
APPROVED BY:	
SCALE:	NONE
SIZE:	15224E1804
PROJECT NUMBER:	DDS40
REV:	0
DATE:	12/08/06
REVISION:	FOR FINAL REVIEW/BUILDING PERMIT

CITY OF STAMFORD CONNECTICUT
SOLIDS DRYING PROJECT
PELLETIZING TRAIN GROUP 002
LOOP DIAGRAM

PROJECT NUMBER 1524
DRAWING NUMBER EI-804
SHEET 2 OF 2



THIS DRAWING IS COPY RIGHTED
FOR HIS PERSONAL USE WITHOUT THE SIGNED WRITTEN CONSENT OF ANDRITZ-RUTHNER, INC. IT MUST NOT BE COPIED NOR MADE AVAILABLE TO THIRD PARTIES. INCLUDING COMPETITORS, NOR MADE ACCESSIBLE TO SUCH PARTIES. ANY ILLEGAL USE BY THE RECEIVER OR THIRD PARTIES FOR WHICH HE IS RESPONSIBLE CAN CONSTITUTE A CAUSE FOR LEGAL ACTION. THIS DRAWING MUST BE RETURNED ON REQUEST OF THE COMPANY.