


1 FIELD

2 REMOTE I/O

4 MCC BUCKET

6 PANEL

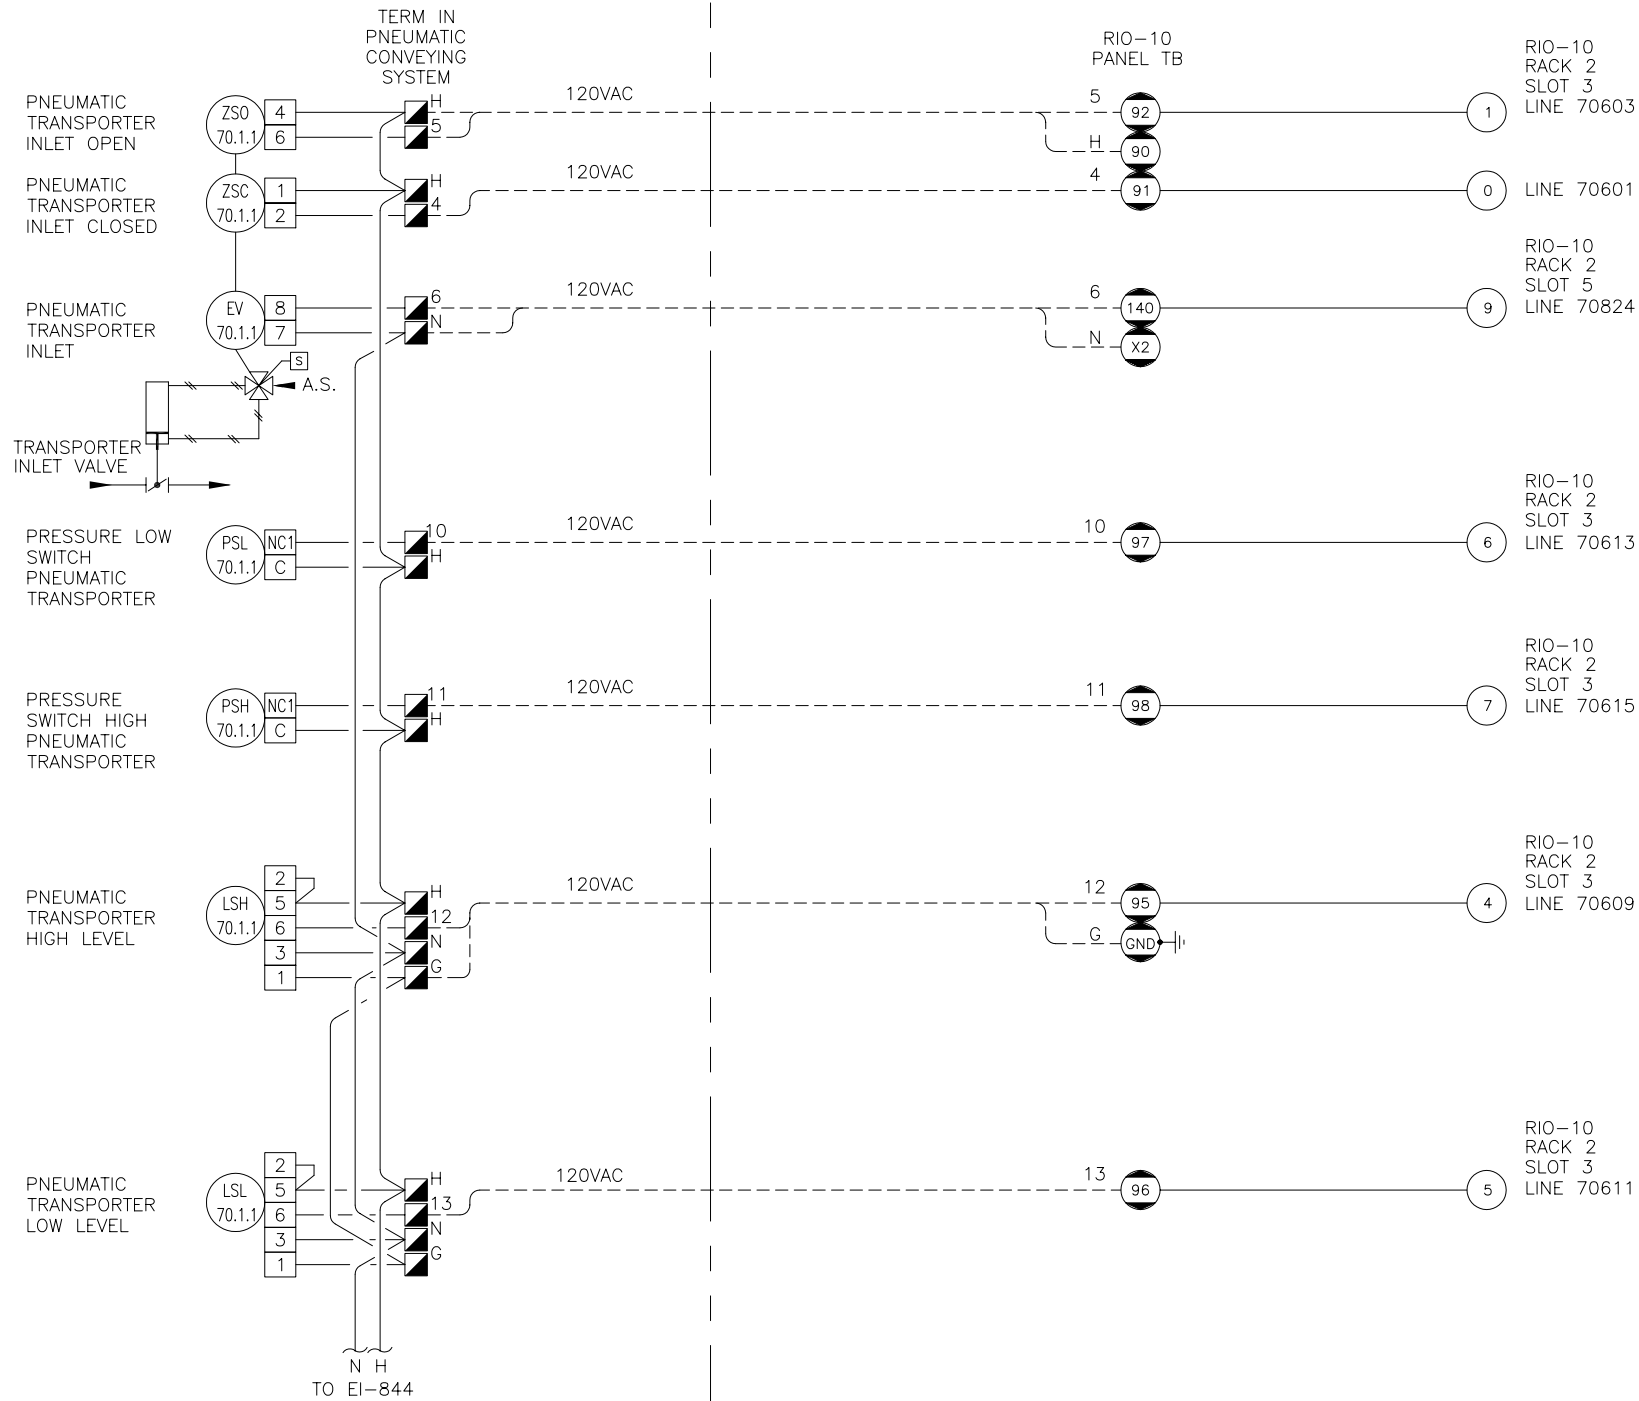

REV	DATE	DESCRIPTION
0	12/08/06	FOR FINAL REVIEW/BUILDING PERMIT

DATE:	3/20/06
CHECKED BY:	BB
APPROVED BY:	
SCALE:	NONE
FILE:	1524EIB43
SIZE:	
PROJECT NUMBER:	DDS40

JOB NAME:	CITY OF STAMFORD CONNECTICUT SOLIDS DRYING PROJECT
TITLE:	PELLETIZING TRAIN GROUP 070 LOOP DIAGRAM
PROJECT NUMBER:	1524
DRAWING NUMBER:	EI-843
SHEET:	1 OF 3
REV:	0

RELEASED 12/08/06  
REVISION - 0



TAG	DESCRIPTION	MANUFACTURER	MODEL NO.	CALIBRATION
EV-70.1.1	VALVE	BRAY	X	X
ZSO-70.1.1	POSITION SWITCH OPEN	BRAY	X	X
ZSC-70.1.1	POSITION SWITCH CLOSED	BRAY	X	X
PSH-70.1.1	PRESSURE SWITCH HIGH	BARKSDALE	P2X-A80SS	X
PSL-70.1.1	PRESSURE SWITCH LOW	BARKSDALE	P2X-A80SS	X
LSH-70.1.1	LEVEL SWITCH HIGH	AMETEX	ZTRON III	X
LSL-70.1.1	LEVEL SWITCH LOW	AMETEX	ZTRON III	X

THIS DRAWING IS A TRADE SECRET AND ONLY ENTRUSTED TO THE RECEIVER FOR HIS PERSONAL USE. WITHOUT THE SIGNED WRITTEN CONSENT OF ANDRITZ-RUTHNER, INC., IT MUST NOT BE COPIED NOR MADE AVAILABLE TO THIRD PARTIES. INCLUDING COMPETITORS, NOR MADE ACCESSIBLE TO SUCH PARTIES. ANY ILLEGAL USE BY THE RECEIVER OR THIRD PARTIES FOR WHICH HE IS RESPONSIBLE CAN CONSTITUTE A CAUSE FOR LEGAL ACTION. THIS DRAWING MUST BE RETURNED ON REQUEST OF THE COMPANY.