

1

2

3

4

5


6

FIELD

REMOTE I/O

MCC BUCKET



PANEL

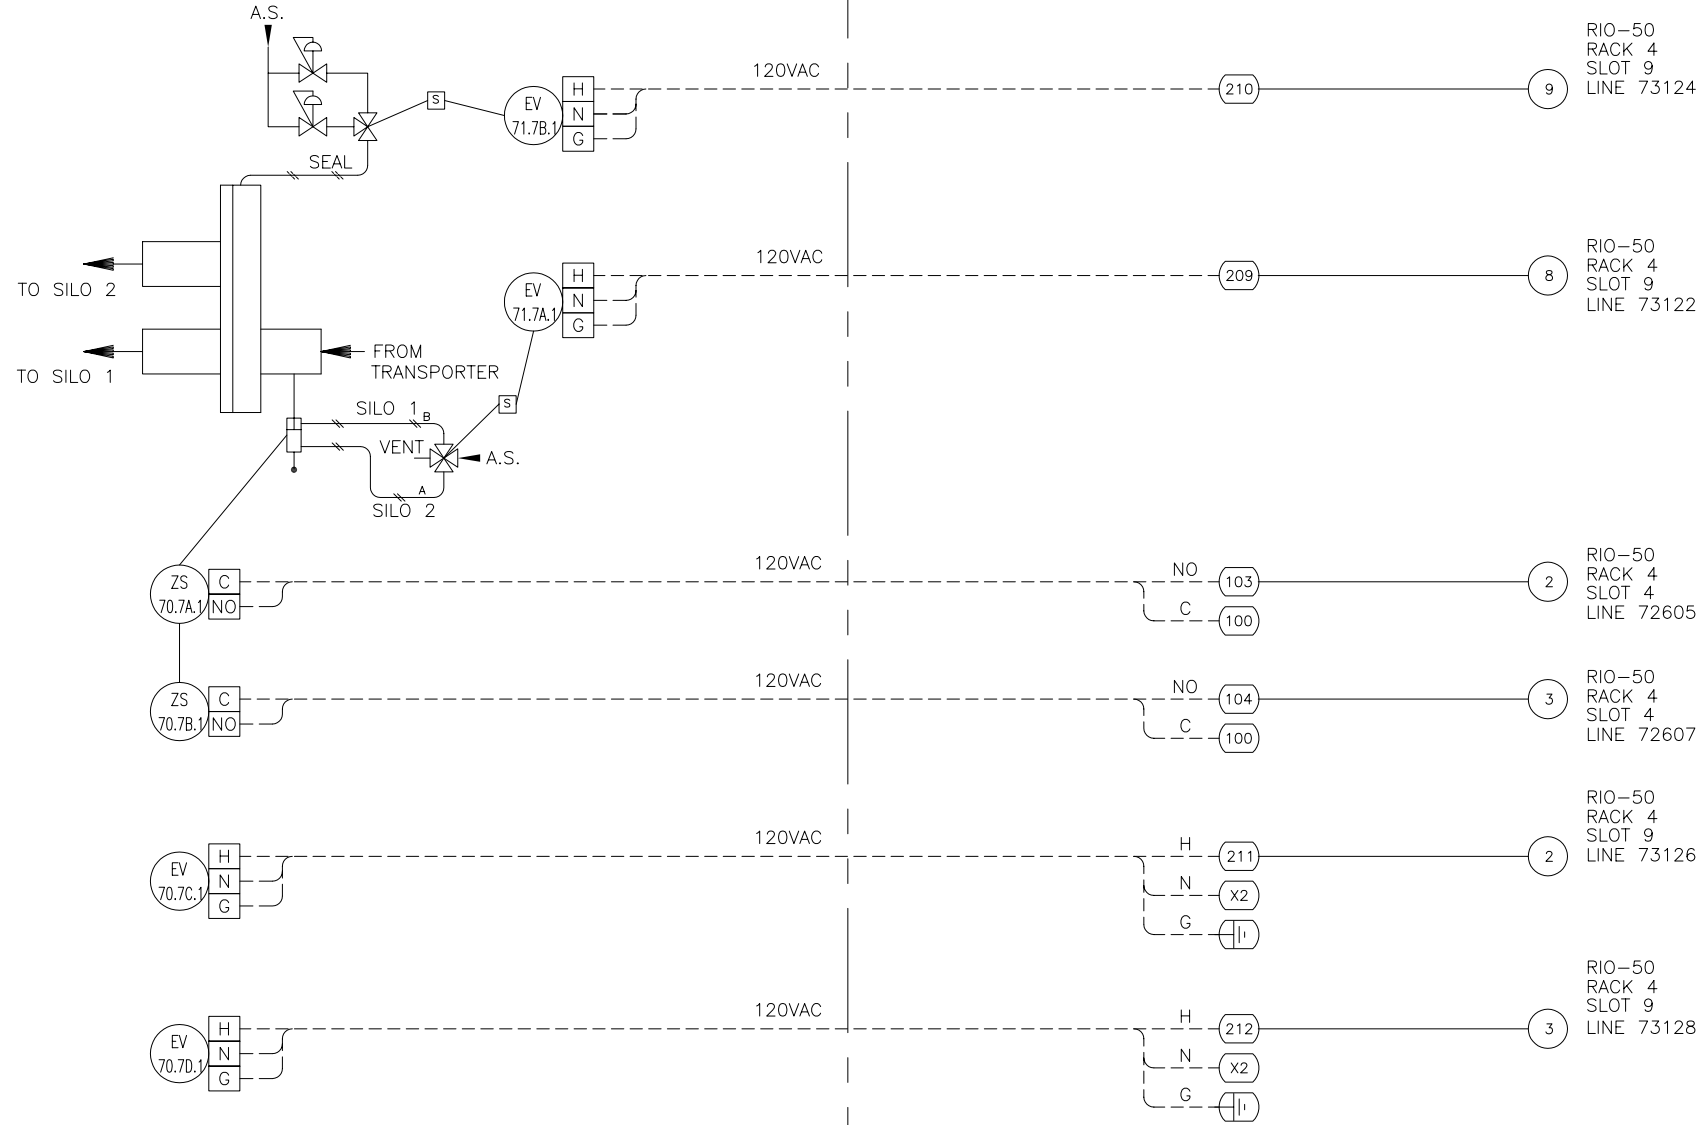

TAG	DESCRIPTION	MANUFACTURER	MODEL NO.	CALIBRATION
EV-70.7A.1	DIVERTER VALVE POSITION SOLENOID	X	X	X
EV-70.7B.1	DIVERTER VALVE SEAL SOLENOID	X	X	X
ZS-70.7A.1	POSITION SWITCH	X	X	X
ZS-70.7B.1	POSITION SWITCH	X	X	X
EV-70.7C.1	BOOSTER AIR SOLENOID VALVE SILO 1	X	X	X
EV-70.7D.1	BOOSTER AIR SOLENOID VALVE SILO 2	X	X	X

THIS DRAWING IS COPY RIGHTED  
 FOR HIS PERSONAL USE WITHOUT THE SIGNED WRITTEN CONSENT OF ANDRITZ-  
 RUTHNER, INC., IT MUST NOT BE COPIED NOR MADE AVAILABLE TO THIRD PARTIES.  
 INCLUDING COMPETITORS, NOR MADE ACCESSIBLE TO SUCH PARTIES. ANY ILLEGAL  
 USE BY THE RECEIVER OR THIRD PARTIES FOR WHICH HE IS RESPONSIBLE CAN  
 CONSTITUTE A CAUSE FOR LEGAL ACTION. THIS DRAWING MUST BE RETURNED ON  
 REQUEST OF THE COMPANY.

RELEASED 12/08/06  
 REVISION



DATE:	3/21/06	DATE:		DATE:	12/08/06	DATE:	
DRAWN BY:	BB	CHECKED BY:		APPROVED BY:		SCALE:	NONE
FILE:	1524E1845	SIZE:		REV:	0	FOR FINAL REVIEW/BUILDING PERMIT	REVISION

DDSS40

CITY OF STAMFORD CONNECTICUT  
 SOLIDS DRYING PROJECT  
 PELLETIZING TRAIN GROUP 070  
 LOOP DIAGRAM

PROJECT NUMBER 1524  
 DRAWING NUMBER EI-845  
 SHEET 3 OF 3